


All 120 Volt Receptacles
Shall Be GFCI Type or Fed
By GFCI Circuit Breaker
and Have Weatherproof
Receptacle Covers.

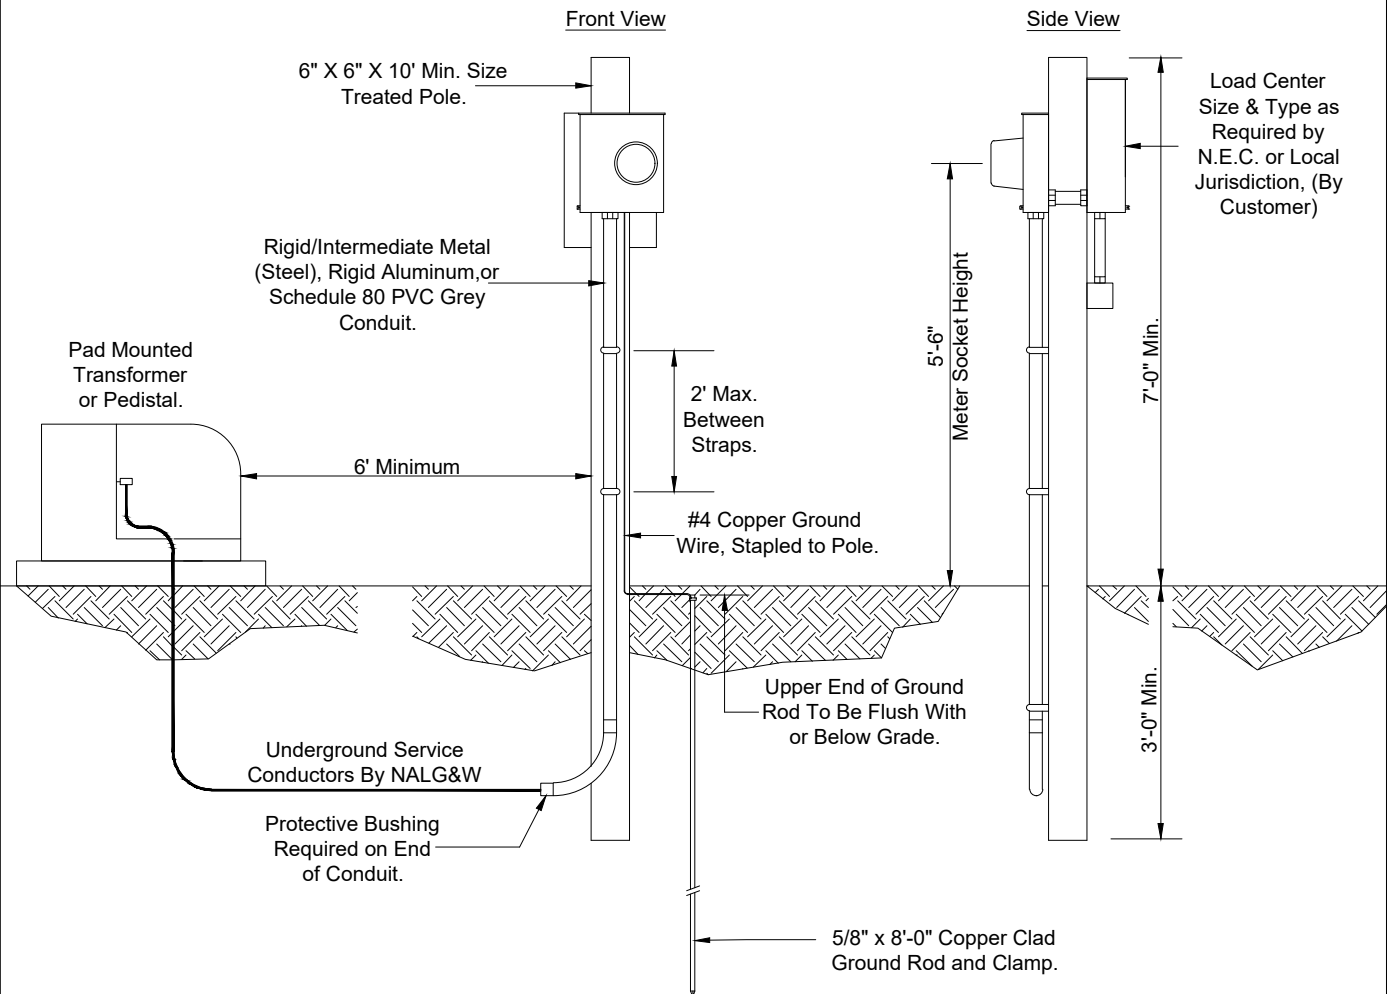

General Notes:

1. Meter Socket and Conduit Straps Shall Be Fastened to Pole using Wood Screws. All Screws and Bolts Shall Be Corrosion Resistant.
2. For Pole Location Consult with NALG&W.
3. **GROUNDING, REFER TO DRAWING NO. NALG&W-018 AND NALG&W-019.**

Minimum Customer Wiring Size - Single Phase

Meter Size	Conduit size	Phase Wire Size (per NEC)	Neutral Wire Size (per NEC)	Ground Wire Size
		Copper	Copper	
100 Amp	2"	#2	#2	#4
200 Amp	2-1/2"	#3/0	#1/0	#4
320 Amp	3"	500 MCM	500 MCM	#1/0

NO.	DATE:	REVISION:	BY:	APPR:
1.	8/20/25	REVISED GENERAL NOTE 3.	WDG	WDG



TEMPORARY SERVICE FROM AN UNDERGROUND SOURCE

DRAWN BY:	R.E.W.	JOB NO.	113E6001
CHECKED BY:	J.A.	DATE	DECEMBER, 2025
APPROVED BY:		SCALE	NONE

DRAWING NO. NALG&W - 007

SHEET 1 OF 1