


Maximum Recommended Overhead Service Length (Triplex Conductors)	
Service Size	Length
100 Amp	100'
200 Amp	75'

Pole Length Determined by Service Drop Clearance Requirements.
 13'-6" Above Sidewalks (Restricted Traffic)
 18' Minimum Vertical Clearance Above Residential and Public Driveways, Alleys, Roads and Construction Areas

Pole Specifications: (a) 15" Minimum Circumference Pressure Treated CCA or Penta. (b) Penta 6" x 6" Square Treated Timber Minimum.

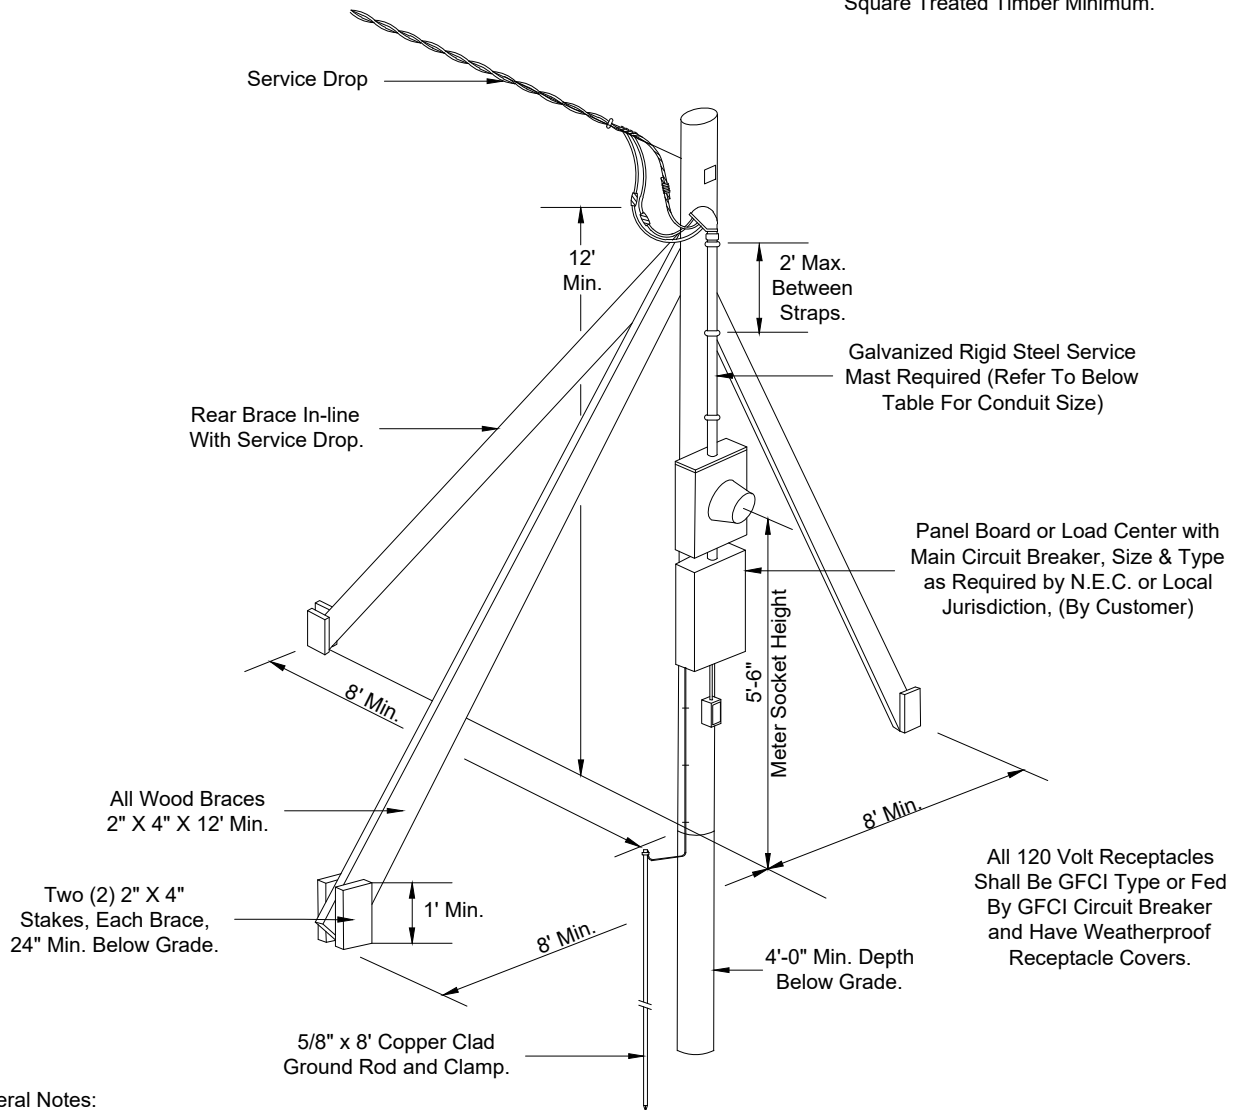

General Notes:

1. Meter Socket and Conduit Straps Shall Be Fastened to Pole using Wood Screws. All Screws and Bolts Shall Be Corrosion Resistant.
2. A Minimum of 18" of Each Conductor Shall Extend from the Top of the Service Mast. The NEUTRAL Shall Be Marked with White Tape at Both Ends.
3. No Telephone or Cable Attachment Allowed on Service Mast.
4. Point of Attachment Shall Be Accessible to NALG&W's Bucket Truck.
5. 5/8" x 8' Ground Rod with Bronze Ground Clamps Flush or Just Below Ground Level.
6. **GROUNDING, REFER TO DRAWING NO. NALG&W-018 AND NALG&W-019.**

CONSTRUCTION SERVICE ONLY

NO.	DATE:	REVISION:	BY:	APPR:
1.	8/20/25	ADDED GENERAL NOTE 6.	WDG	WDG



TEMPORARY OVERHEAD SERVICE POLE

DRAWN BY:	R.E.W.	JOB NO.	113E6001
CHECKED BY:	J.A.	DATE	DECEMBER, 2025
APPROVED BY:		SCALE	NONE

DRAWING NO. NALG&W - 006

SHEET 1 OF 1