


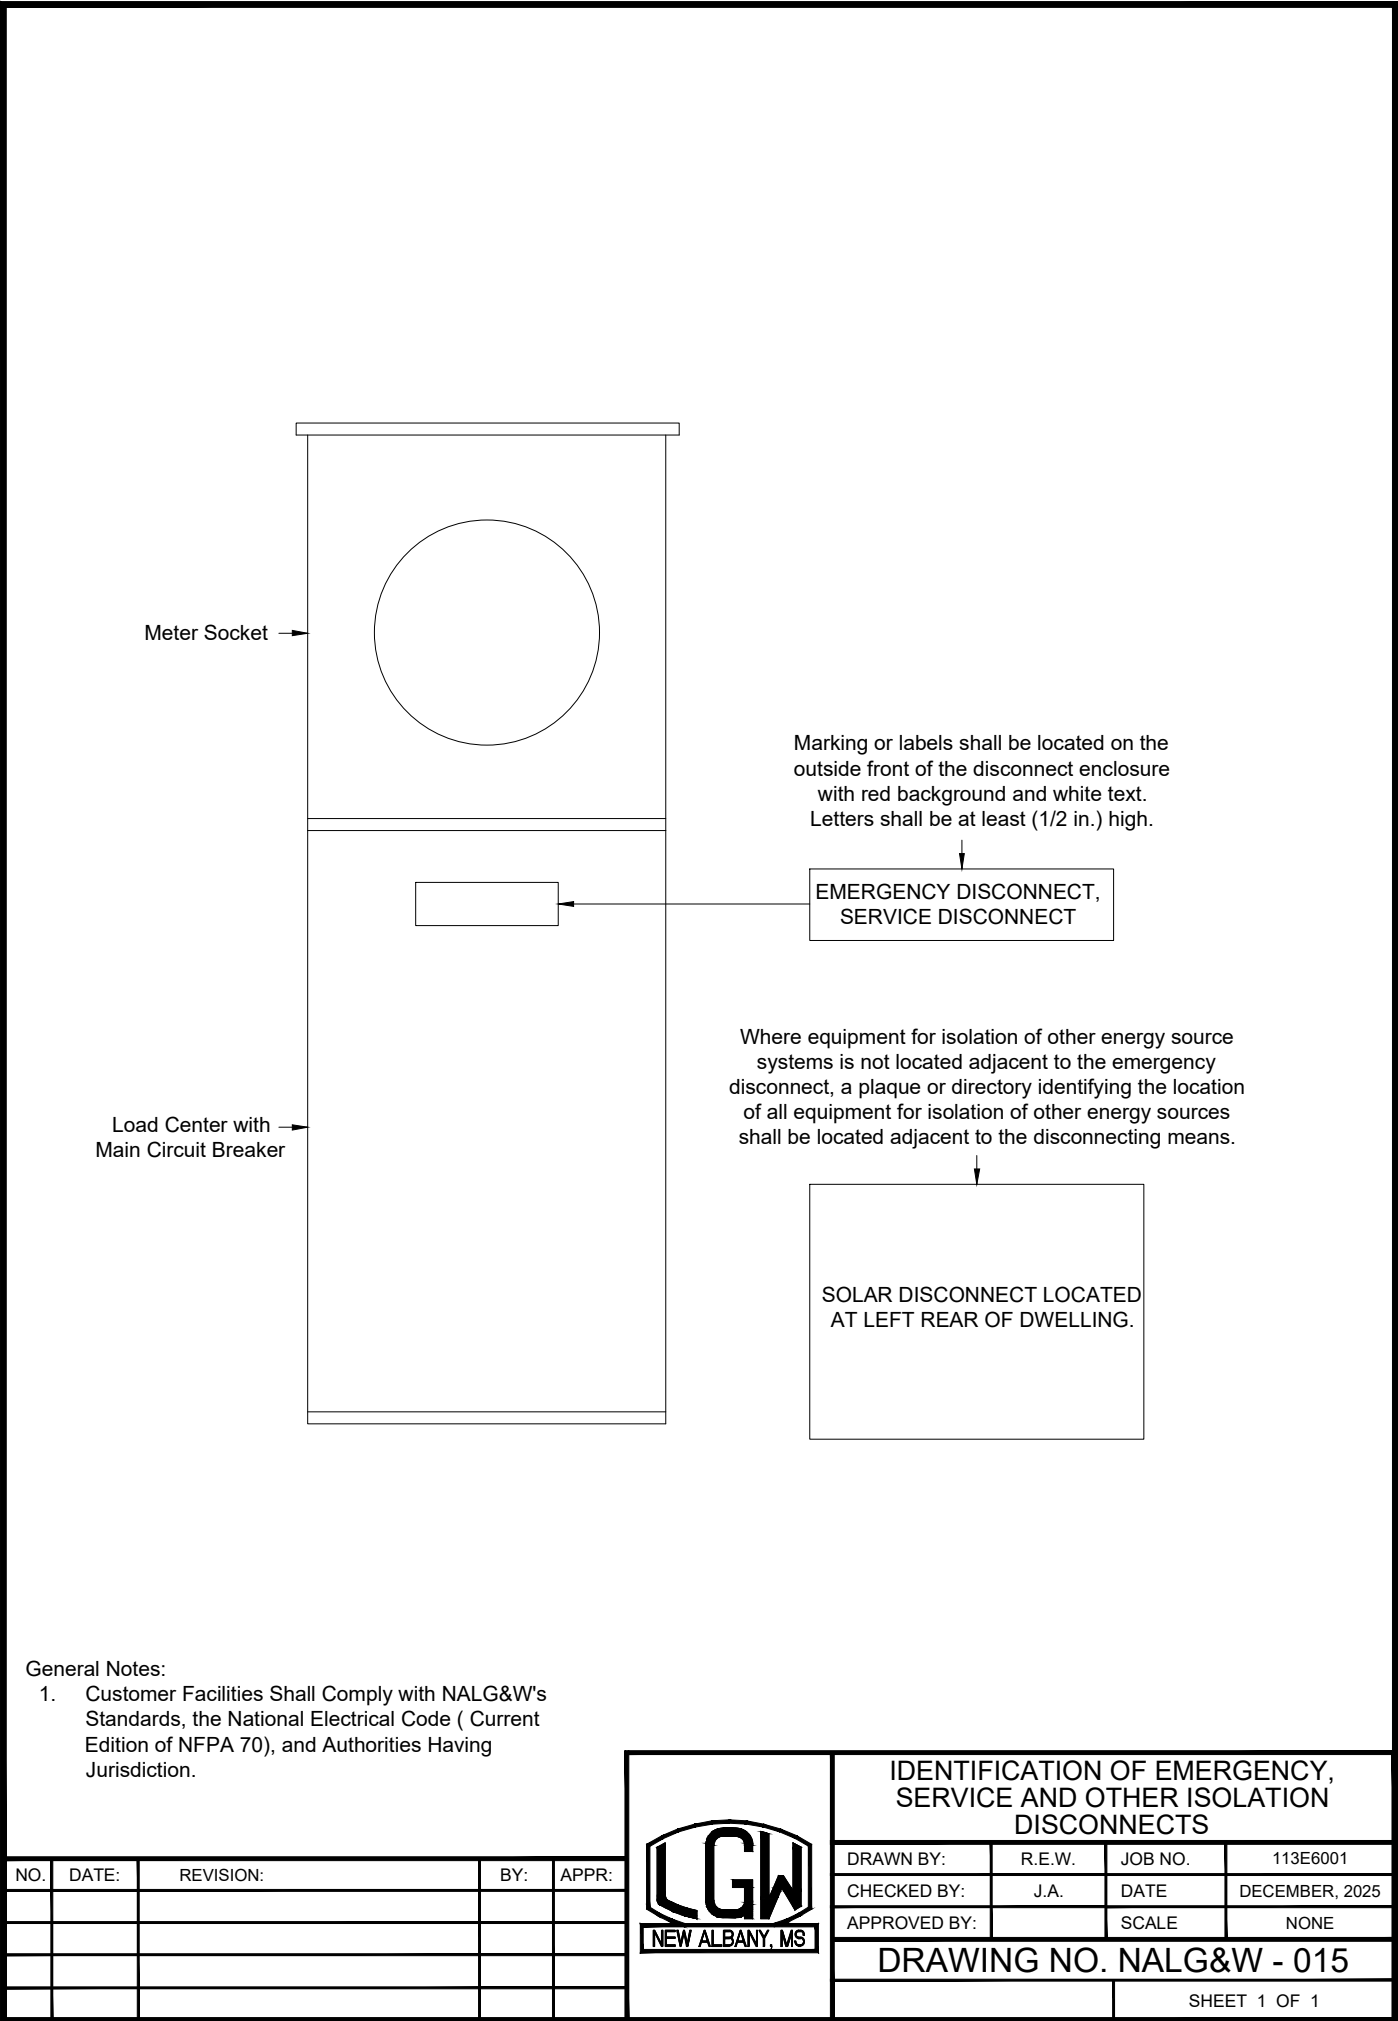


General Notes:

- 1. Customer Facilities Shall Comply with NALG&W's Standards, the National Electrical Code (Current Edition of NFPA 70), and Authorities Having Jurisdiction.

NO.	DATE:	REVISION:	BY:	APPR:

IDENTIFICATION OF EMERGENCY, SERVICE AND OTHER ISOLATION DISCONNECTS			
DRAWN BY:	R.E.W.	JOB NO.	113E6001
CHECKED BY:	J.A.	DATE	DECEMBER, 2025
APPROVED BY:		SCALE	NONE
DRAWING NO. NALG&W - 015			
		SHEET 1 OF 1	



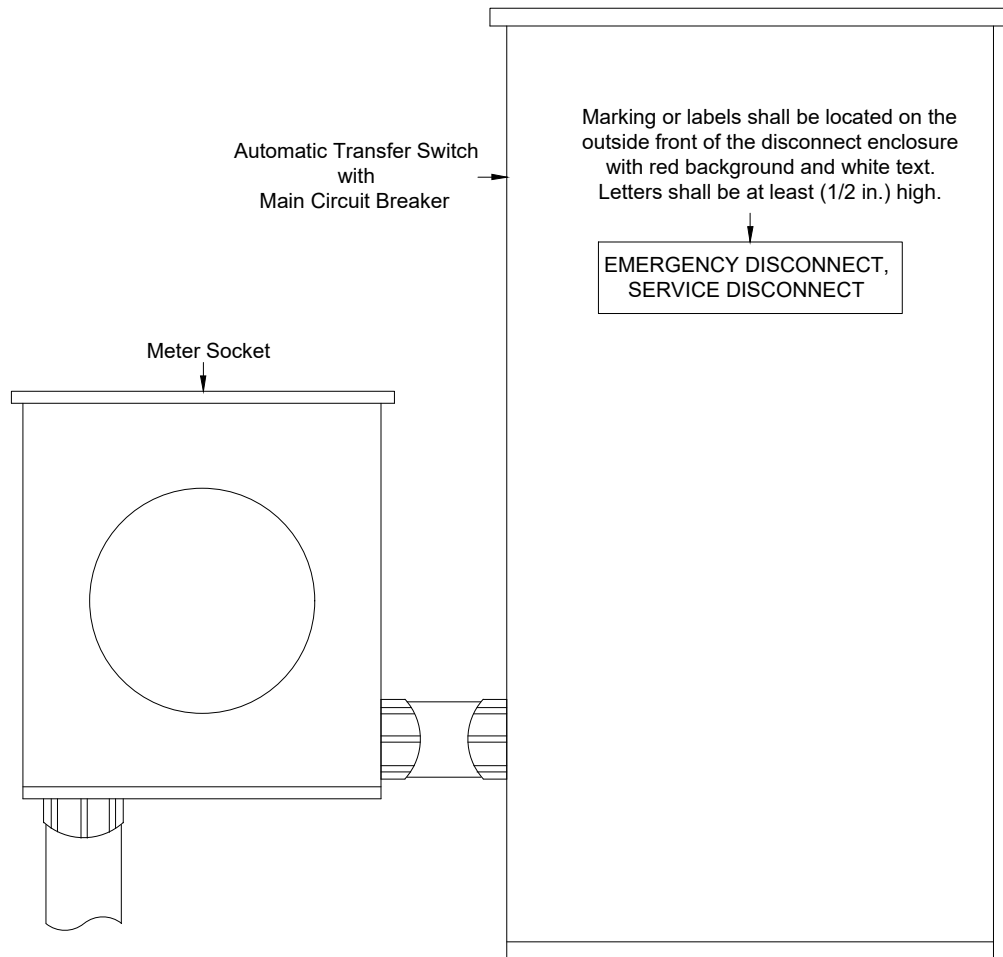

SOLAR DISCONNECT LOCATED
AT LEFT REAR OF DWELLING.

Where equipment for isolation of other energy source systems is not located adjacent to the emergency disconnect, a plaque or directory identifying the location of all equipment for isolation of other energy sources shall be located adjacent to the disconnecting means.


General Notes:

1. Customer Facilities Shall Comply with NALG&W's Standards, the National Electrical Code (Current Edition of NFPA 70), and Authorities Having Jurisdiction.

NO.	DATE:	REVISION:	BY:	APPR:

IDENTIFICATION OF EMERGENCY, SERVICE AND OTHER ISOLATION DISCONNECTS			
DRAWN BY:	R.E.W.	JOB NO.	113E6001
CHECKED BY:	J.A.	DATE	DECEMBER, 2025
APPROVED BY:		SCALE	NONE
DRAWING NO. NALG&W - 016			
		SHEET 1 OF 1	



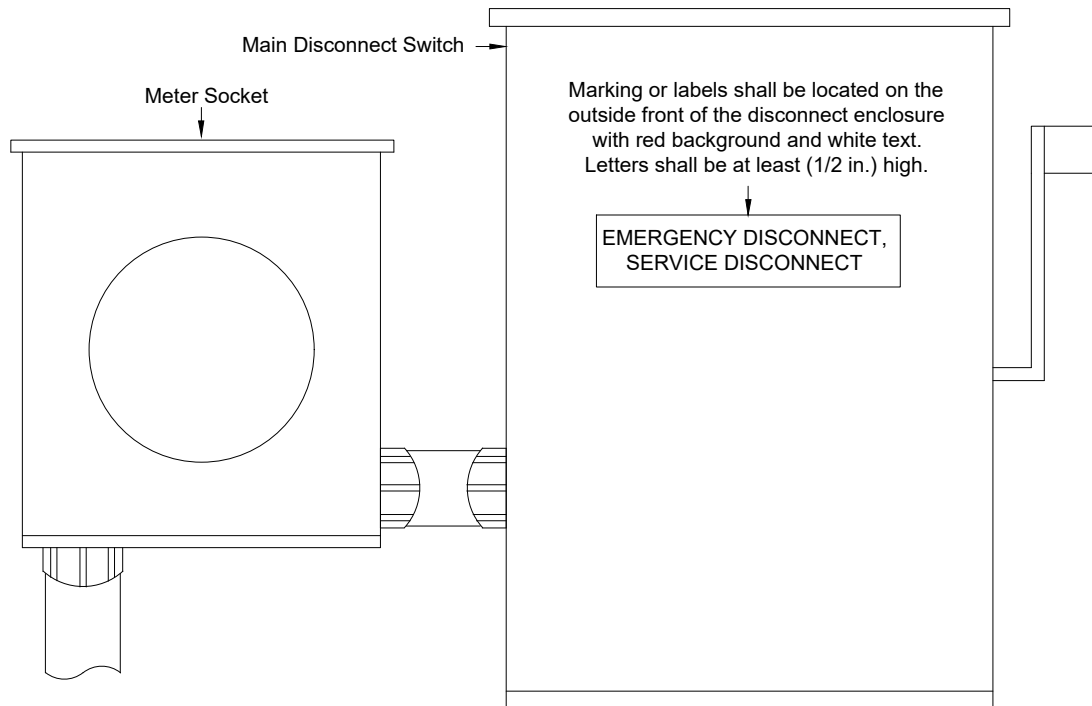

General Notes:

- Customer Facilities Shall Comply with NALG&W's Standards, the National Electrical Code (Current Edition of NFPA 70), and Authorities Having Jurisdiction.

NO.	DATE:	REVISION:	BY:	APPR:



**IDENTIFICATION OF EMERGENCY,
SERVICE DISCONNECTS**

DRAWN BY:	R.E.W.	JOB NO.	113E6001
CHECKED BY:	J.A.	DATE	DECEMBER, 2025
APPROVED BY:		SCALE	NONE

DRAWING NO. NALG&W - 017

SHEET 1 OF 1