



FRONT ELEVATION

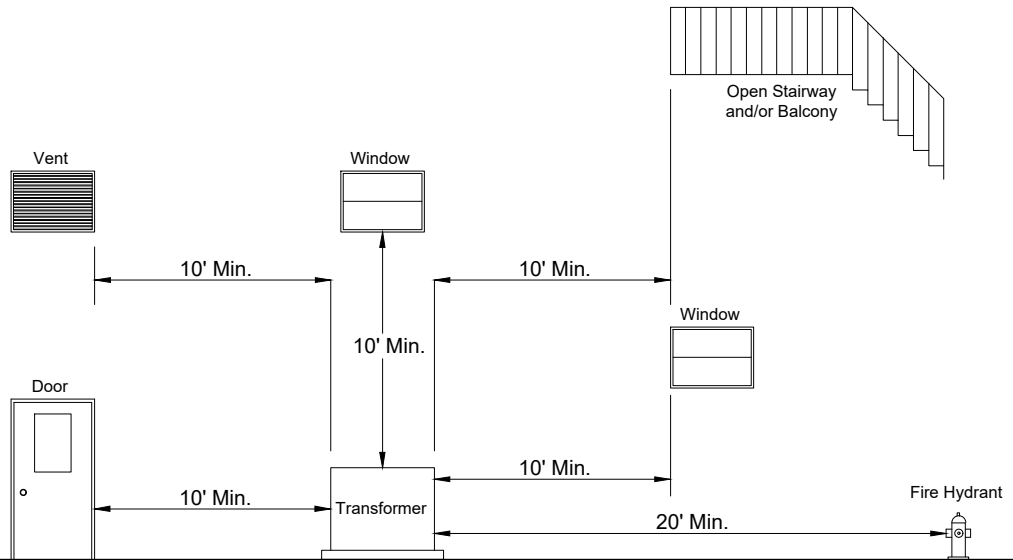

TOP ELEVATION

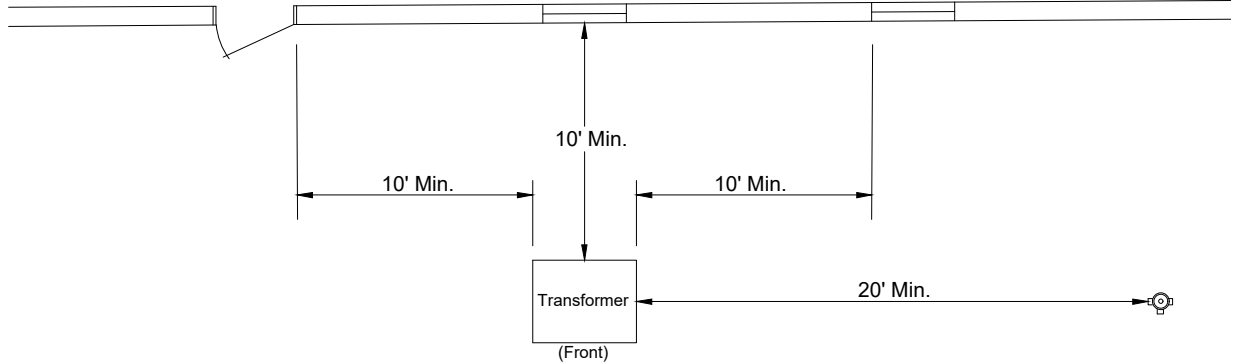

General Notes:

- Transformer Shall Be Installed Such That the Side Designated as "FRONT" Does Not Face the Building.
- A Clear Passageway MUST Be Maintained to Accommodate Line Trucks or Other Necessary Lifting and Hauling Equipment to Allow for Maintenance, Operation or Replacement.
- No Portion of the Building Shall Extend Over the Transformer.
- The Transformer Shall Not be Enclosed or Otherwise Surrounded by the Building, Leaving the Transformer Without Access.
- For Cooling Purposes, Landscaping, Fencing and Other Above Ground Obstructions Shall Not Be Allowed Within Six (6) feet of the Sides or Back of the Transformer.
- A Fifteen (15) foot CLEAR Operating Zone Shall Be Maintained on the Transformer Side Designated as "FRONT".
- The Concrete Transformer Pad Shall Be at the Same Elevation as the Building. Drainage Shall be Away from the Building.
- Downspouts Shall Be Directed AWAY from the Transformer.
- The CUSTOMER SHALL BE Responsible for Compliance with any Building Codes, Local Ordinances, and Insurance Requirements affecting the Transformer Installation.

NO.	DATE:	REVISION:	BY:	APPR:



LOCATION OF PAD MOUNTED TRANSFORMERS AND OTHER OIL FILLED EQUIPMENT

DRAWN BY:	R.E.W.	JOB NO.	113E6001
CHECKED BY:	J.A.	DATE	DECEMBER, 2025
APPROVED BY:		SCALE	NONE

DRAWING NO. NALG&W - 012

SHEET 1 OF 1